

Plotting File: \\S:\03-Va Shreveport 3rd and 4th Floors\Drawings\007-5123 PL 103 Fourth Floor-Waste Drain and Vent.dwg
Plotted by: DBarnhart
Plotted Date: May 11, 2015 3:55pm

three inches = one foot

one and one-half inches = one foot

one inch = one foot

three-quarters inch = one foot

one-half inch = one foot

three-eighths inch = one foot

one-quarter inch = one foot

one-eighth inch = one foot

NEW WORK KEYED NOTES: (THIS DRAWING ONLY)



- ① 6"SD-UP TO ROOF DRAIN.
- ② VENT PIPING UP TO VENT THRU ROOF.
- ③ PROVIDE AND INSTALL NEW 2" HUB DRAIN IN CABINET SPACE FOR ICE MAKER.
- ④ PROVIDE AND INSTALL NEW FLOOR DRAIN WITH CHEMICALLY RESISTANT ELASTOMER FLOOR DRAIN TRAP SEAL PROTECTION DEVICE.
- ⑤ 4"SD-UP&DN.

GENERAL NOTES

- THESE DRAWINGS ARE DIAGRAMMATIC ONLY AND ARE NOT TO BE SCALED. FIELD VERIFY ALL DIMENSIONS, PIPE SIZES, AND INVERTS. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS AND LOCATIONS OF ALL PLUMBING FIXTURES AND EQUIPMENT.
- COORDINATE PIPE ROUTING WITH DUCT ROUTING, EQUIPMENT LOCATIONS, ELECTRICAL INSTALLATIONS, AND BUILDING STRUCTURAL MEMBERS. OFFSET PIPING WHERE REQUIRED TO AVOID CONFLICTS. AVOID PENETRATING ANY MAIN STRUCTURAL BEAM. NOTIFY COR OF ANY CONFLICTS.
- CONTRACTOR SHALL REMOVE AND REPAIR PORTIONS OF FLOORS, CEILINGS AND/OR SLABS AFFECTED BY PLUMBING MODIFICATIONS. REPAIR SURFACES TO MATCH EXISTING UNLESS NOTED OTHERWISE ON ARCHITECTURAL DRAWINGS.
- CONTRACTOR SHALL INSPECT AND ROD OUT EXISTING SANITARY WASTE AND/OR SEWER PIPING BEFORE MAKING ANY NEW CONNECTIONS. CONTRACTOR SHALL NOTIFY OWNER AND COR OF ALL SANITARY SEWER WHICH IS NOT SERVICEABLE AND REQUIRE REPLACEMENT.
- PRIOR TO PERFORMING ANY PLUMBING WORK OR PURCHASING ANY MATERIALS VERIFY EXACT LOCATION, ROUTING, AND PIPE SIZES, ETC. OF ALL EXISTING SANITARY SEWER, VENT, AND STORM DRAINAGE PIPING.
- PROVIDE CLEANOUT(S) AS REQUIRED BY INTERNATIONAL PLUMBING CODE, LOCAL CODE, AND/OR WHERE HORIZONTAL SANITARY SEWER PIPING CHANGES DIRECTION OVER 45°.
- NEW 2" SANITARY SEWER PIPING SHALL BE SLOPED A MINIMUM TWO PERCENT, ONE-QUARTER INCH PER FOOT. NEW 3" AND 4" SANITARY SEWER PIPING SHALL BE SLOPED A MINIMUM ONE PERCENT, ONE-EIGHT INCH PER FOOT.
- ALL HORIZONTAL STORM DRAINAGE PIPING SHALL BE INSULATED.
- REFER TO ISOMETRIC RISER DIAGRAMS PLUMBING DRAWING PL201 FOR PIPE SIZES.


WASTE DRAIN AND VENT PIPING FOURTH FLOOR NEW WORK PLAN

SCALE: 1/8" = 1'-0"



CONSULTANTS:

CLARK•NEXSEN
440 MARTIN LUTHER KING, JR. BLVD.
MACON, GA 31201
478-743-8415 FAX 478-743-8239
WWW.CLARKNEXSEN.COM

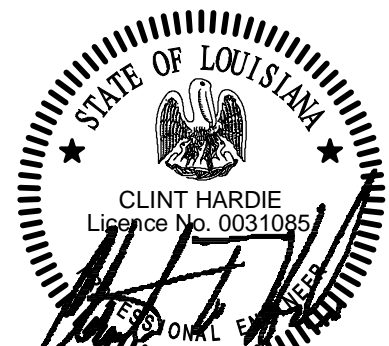

ARCHITECT:



590 Means Street NW, Suite 200
Atlanta, GA 30318
404.214.9774

Drawing Title:

WASTE DRAIN AND VENT PIPING
FOURTH FLOOR NEW WORK PLAN

Approved: Project Director

Project Title:

EXPAND RADIOLOGY AND SPS
OVERTON BROOKS VAMC

Location:

SHREVEPORT, LA

Date:
04-17-2015

Checked:
CARLTON

Drawn:
BARNHART

Project Number:

667-083

Building Number:

1

Drawing Number:

PL103

Dwg. 95 of 160

FINAL SUBMITTAL

OFFICE OF
CONSTRUCTION
AND FACILITIES
MANAGEMENT

